

APPLICATION FOR POLE LOCATIONS

July 23, 2018

To the Board of Councilors
of Windham, Maine

NORTHERN NEW ENGLAND TELEPHONE OPERATIONS LLC and CENTRAL MAINE POWER COMPANY respectfully request(s) permission for a location for poles and cables and wires thereon, including the necessary sustaining, supporting and protecting fixtures in, along, upon and across the following named public streets and highways:

IN THE TOWN OF WINDHAM, MAINE


Windham Center Road – Replacement of 13 Poles, beginning at Pole 508 [75] approximately 900 feet Northwesterly of the intersection of center line US Route 202/4; thence extending approximately 1670 feet Northwesterly to Pole 522 [88], thirteen poles

THIS APPLICATION IS BEING SUBMITTED WITHOUT PUBLIC NOTICE BY PUBLICATION

Said poles to be erected substantially in accordance with the plan filed herewith marked Consolidated No. 322133 dated July 17, 2018 and shall be of wood or other suitable material, and the cables and wires shall be run at the height in compliance with standards of the National Electrical Safety Code at highway crossings and elsewhere for electric cables and wires, and (or) for telephone cables and wires. All cables and wires to be maintained in accordance with standards of the National Electrical Safety Code.


NORTHERN NEW ENGLAND TELEPHONE
OPERATIONS LLC

By

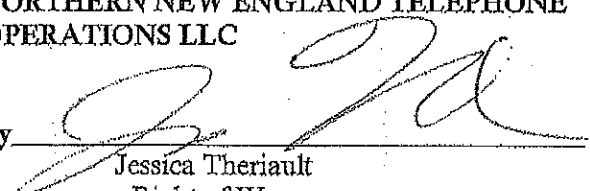
Jessica Theriault
Right of Way

CENTRAL MAINE POWER COMPANY

By

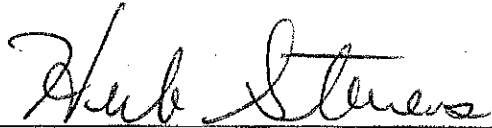
Herb Stevens
Supervisor – Integrated Field Design

PERMIT FOR POLE LOCATIONS

To the Board of Councilors
Windham, Maine

ORDERED: That **NORTHERN NEW ENGLAND TELEPHONE OPERATIONS LLC** and **CENTRAL MAINE POWER COMPANY** be and is/are hereby authorized and permitted to erect and maintain poles and cables and wires to be placed thereon, together with such sustaining, supporting and protecting fixtures as said companies may deem requisite, in, along, upon and across the public streets and highways of said Town of Windham as hereinafter designated, as requested in application of said companies dated the 23rd day of July, 2018.

All construction under this permit shall be in accordance with the following specifications: The poles shall be located between the vehicular traveled section of the way and the limits of the highway, shall be set firmly in the ground, substantially at locations indicated upon the plan marked Consolidated No. **322133** dated **July 17, 2018** filed with said application, and shall be of wood or other suitable material, and the cables and wires shall be run at the height in compliance with standards of the National Electrical Safety Code at highway crossings and elsewhere for electric cables and wires, and (or) for telephone cables and wires.

All cables and wires to be maintained in accordance with standards of the National Electrical Safety Code.

Following are the public streets and highways above referred to:

Windham Center Road – Replacement of 13 Poles, beginning at Pole 508 [75] approximately 900 feet Northwesterly of the intersection of center line US Route 202/4; thence extending approximately 1670 feet Northwesterly to Pole 522 [88], thirteen poles

THIS PERMIT IS BEING GRANTED WITHOUT PUBLIC NOTICE BY PUBLICATION

It is further adjudged and voted that satisfactory proof of validity of the applicant's notice or procedures required by statute has been given upon the application of said companies to erect poles with the cables and wires thereon in, along, upon and across the public streets and highways of Windham, Maine, designated by this permit.

Board of Councilors

1. _____

4. _____

2. _____

5. _____

3. _____

6. _____

PERMIT GRANTED

7. _____

Aug 7, 2018

This permit is recorded in the Records of the Town Clerk of Windham,
Book _____, Page _____

Town Clerk

	SAFETY NOTES:		MOD/REV NO	DATE	EWO NO.	322133
	BEWARE OF TRAFFIC				PRINT	1 OF 2
SIGNATURE:		7/17/2018			PREPARED BY:	MARTIN PEASE
DATE:					C. O. / EXCHANGE NAME:	WINDHAM
PRE CT		YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	RECORD REF:	N/A	C. O. / EXCHANGE CODE:	7375
PRIMARY VOLTAGE TO GROUND		7.2 KV	UNDERGROUND	NA	MUNICIPALITY:	WINDHAM
CABLE PRESS		UNDER PRESS YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	CONDUIT	N/A		
TRANSMISSION		26 GA LIMIT YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>	AMT. BRIDGE TAP	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	MANHOLE LOCATION MH	N/A
					AMT.	KF

WINDHAM CENTER RD
TS 206


TOTAL DISTANCE:
Approx. 1670 FT

LIBRARY
PARKING LOT

LIBRARY

43.79088
-70.41124


A

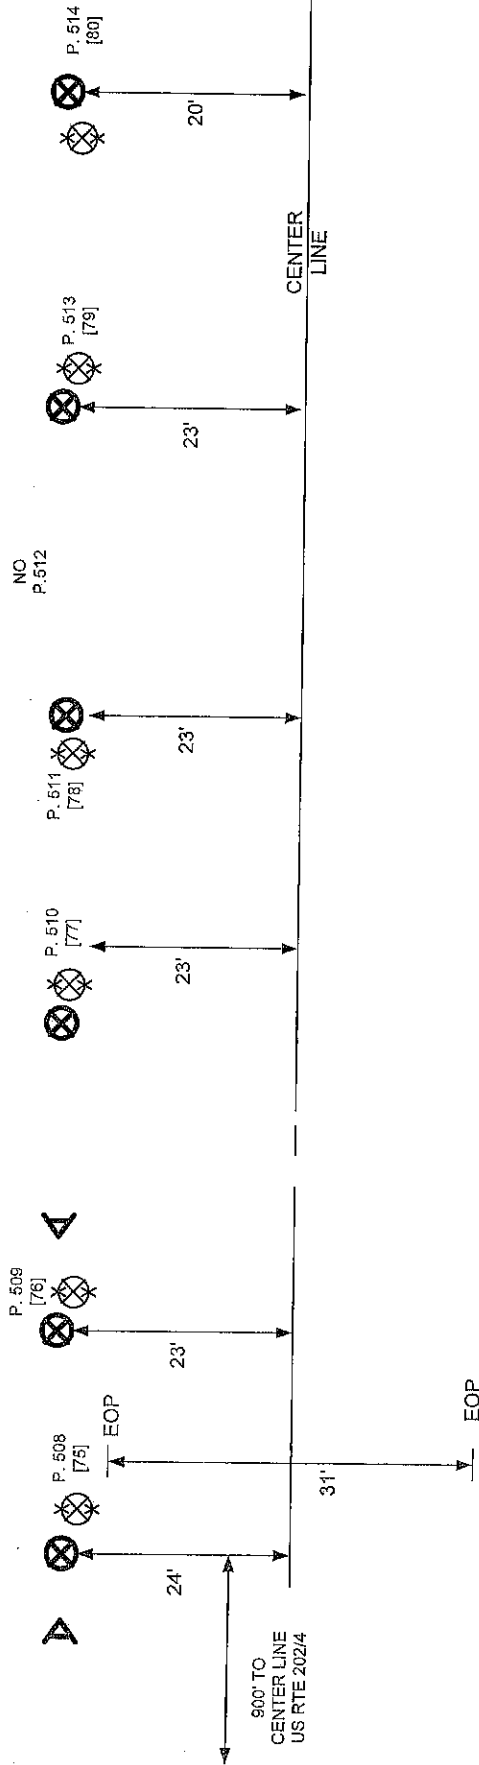

PLAN 2

	SAFETY NOTES:		MOD/REV NO	DATE	EWO NO.	322133
	BEWARE OF TRAFFIC				PRINT	2 OF 2
	SIGNATURE:				PREPARED BY:	MARTIN PEASE
	DATE: 7/17/2018				C.O./EXCHANGE NAME:	WINDHAM
	PRE CT	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	TYPE	RECORD REF:	C.O./EXCHANGE CODE:	7375
	PRIMARY VOLTAGE TO GROUND		AERIAL			
	7.2 KV		UNDERGROUND			
	MGN SYSTEM		BLOCK (NYT)			
	CABLE PRESS	UNDER PRESS YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	CONDUIT		MUNICIPALITY:	WINDHAM
	TRANSMISSION	28 GA LIMIT YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>	BIJFEER YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		MANHOLE LOCATION MH	N/A
				AMT.	KF	

WINDHAM CENTER RD
TS 206

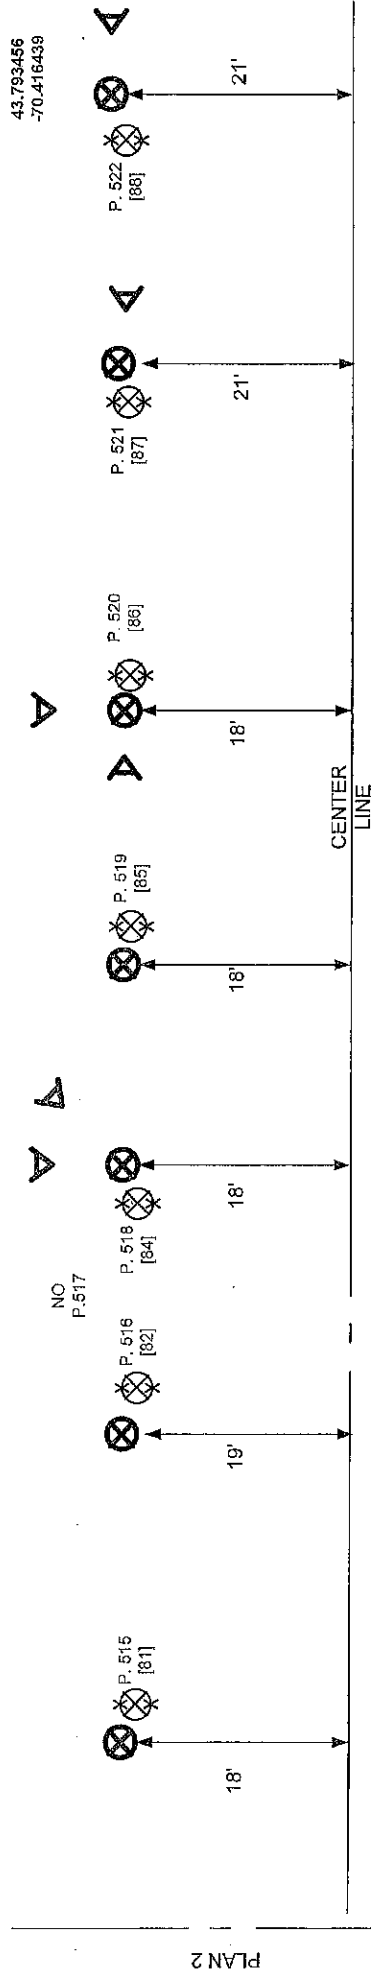

PLAN 2

HALL RD

43.793456
-70.416439

