


Parts List			
Item	Description	Qty	UOM
1	HOLDING TANK LOW LEVEL SHUTOFF	1	EA
2	AIR DIAPHRAGM FEED PUMP	1	EA
3	AIR DIAPHRAGM RESIDUE REMOVAL PUMP	1	EA
4	AUTO-DUMP VALVE, COMES W/ AUTO-DUMP PACKAGE	1	EA
5	AIR ACTUATED FEED ISOLATION VALVE	1	EA

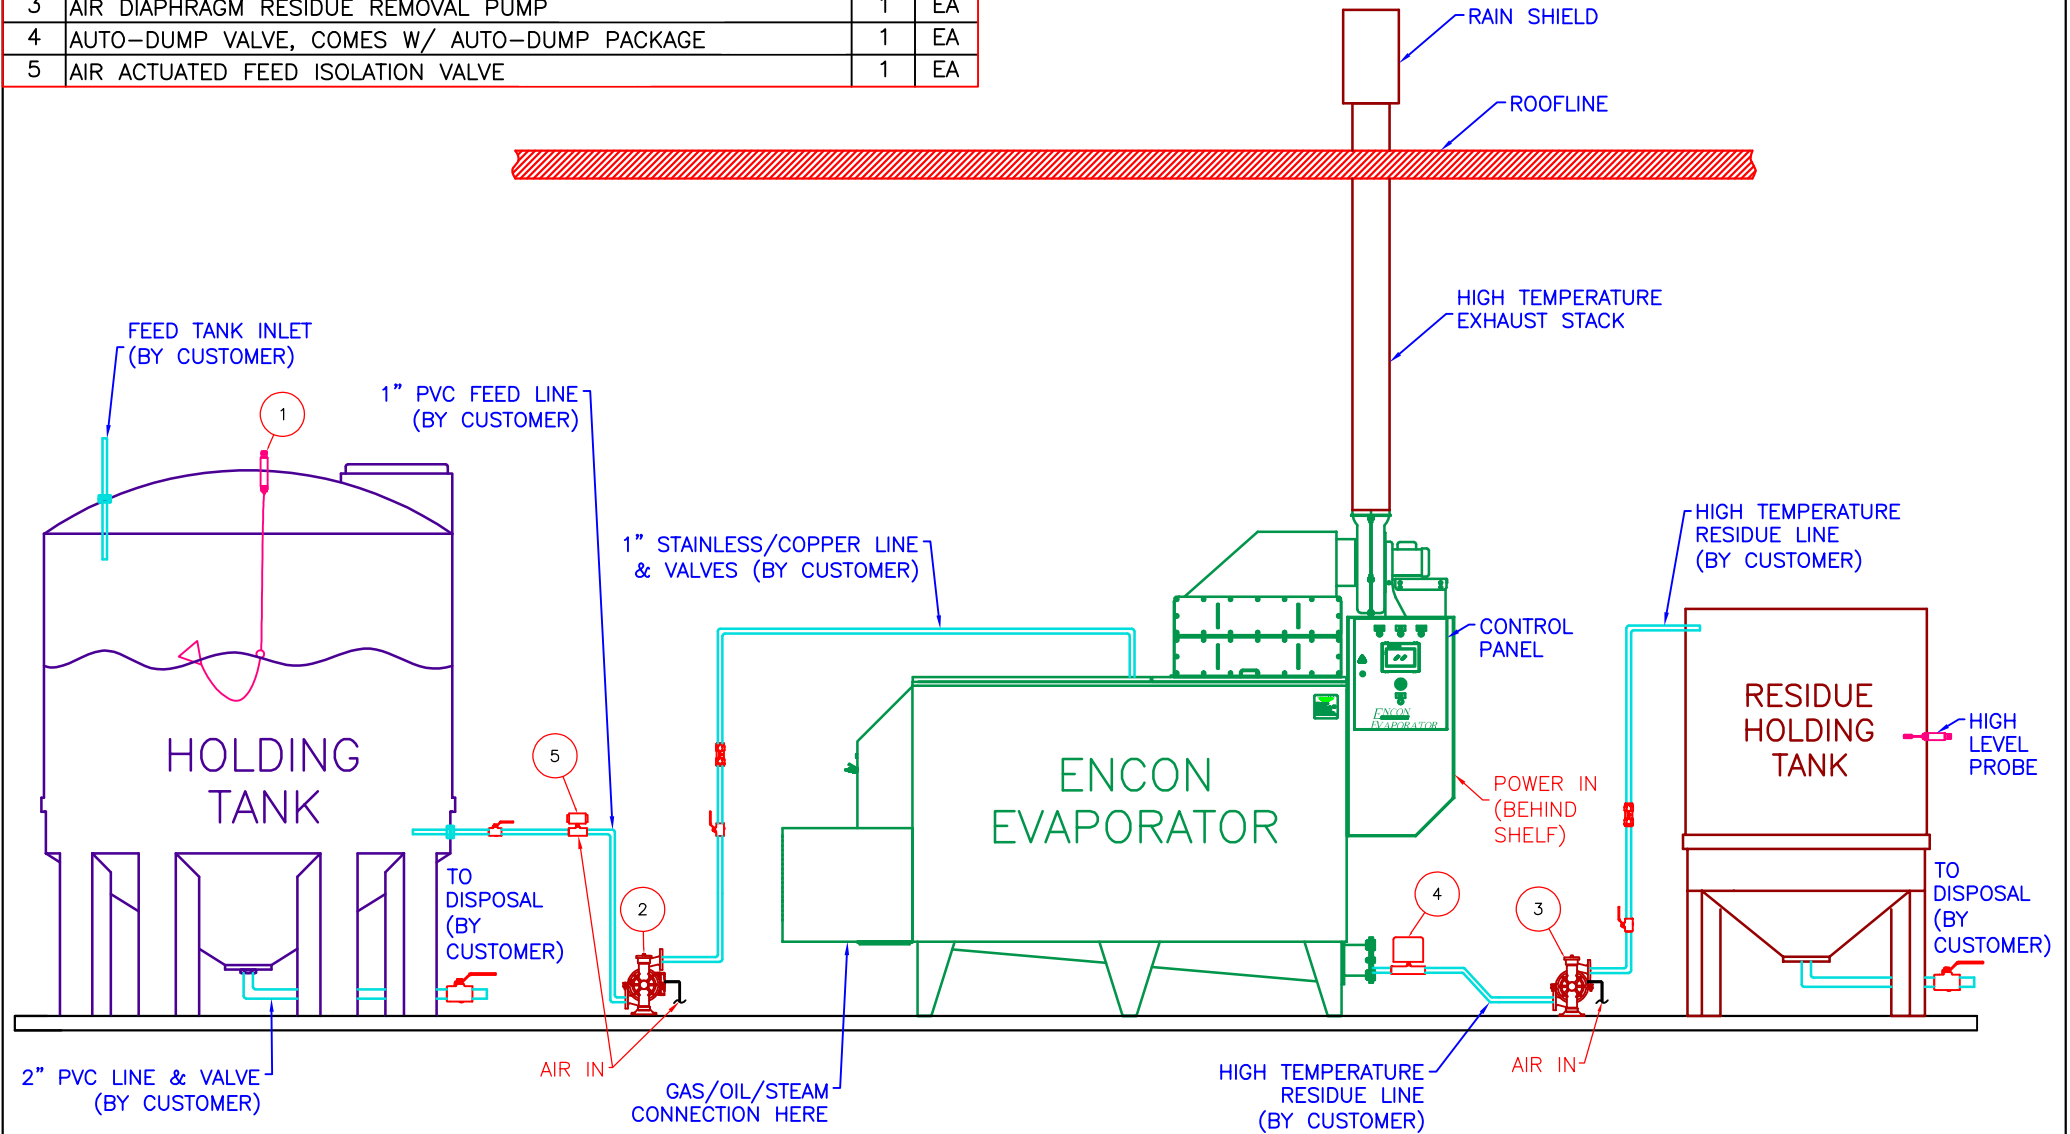

- NOTES:
1. ITEMS LABELED AS OPTIONAL CAN BE SUPPLIED BY ENCON.
 2. FOR GAS FIRED UNITS: GAS METER INSTALLATION IS MANDATORY. THE GAS METER INLET PRESSURE MUST NOT EXCEED 14" W.C.
 3. FOR GAS FIRED UNITS: A MAIN LINE GAS REGULATOR IS MANDATORY (BY CUSTOMER) IF THE MAIN LINE PRESSURE EXCEEDS 14" W.C.
 4. INSTALLATION SHOWN IS TYPICAL. ACTUAL INSTALLATION MAY VARY.

APPROVED	MDC	8/16/17	PART NAME: LAYOUT, ENCON THERMAL EVAPORATOR, TIER 3			
<div>ENCON Evaporators</div> <div>CONFIDENTIAL</div>			PART NUMBER:	3008155-3	REV	A
			SCALE	NTS	SHEET	1 of 1
			DO NOT SCALE DRAWING			FORMAT A